

# OIL COOLING UNIT

Circulating type, for cooling oil

**AKZ14A, AKZ32A, AKZ43A, AKZ56A, AKZ90A** 

High-accuracy, Energy-saving, Compact
Transformerless 400 V specifications
also available
Suited to all applications!

### INDEX

Features

Pages 1 and

Principle and Overall System Diagram / Piping System Diagram

age 3

Nomenclature

age 4

Specifications and Operating range

Pages 5 to

Cooling Capacity Characteristic Chart Pages 9 and

External Dimension Diagram

Pages 11 to 20

### **Optional Parts**

**Thermistor** 

Page 21

Option Board for Communication

Page 2

#### Supplementary Information

Control Panel Operation Mode/ Setting Method

Pages 23 and 24

Electric Wiring Diagram

Electric Wiring Connection Instruction

Notes for Handling

Selection Method

Page 30

Time Line

NEW

Oil Cooling Unit 10 Series

Oil Hydraulic Division

Oil Hydraulic Equipment

# For cooling oil | Circulation type |


AKZ14A, AKZ32A, AKZ43A, AKZ56A, AKZ90A



**Features** 

### Acclaimed high-accuracy temperature control

- Acclaimed high-accuracy ±0.1°C oil temperature control
- The cooling capacity resolution in the low-load range has been improved by optimal control of the compressor/inverter and electronic expansion valve.
- ±0.1°C oil temperature control realized over a load range from 0% (no load) to 100%.




Note: Pattern diagram with the heating load stabilized at 0 - 100%

### Reduced environmental load

 Complies with environmental regulations, e.g. by adopting printed circuit boards with lead-free solder.

### Achieves high energy-saving performance


- Achieve high energy-saving performance with the adoption of a DAIKIN original IPM motor and inverter.
- The power consumption can be checked on the control panel.



- \*1. The comparison reduction costs are based on a Daikin non-inverter system and are shown as 100% consumption.
- \*2. Measured during the operation patterns for DAIKIN models

### Lightweight, compact, transformerless 400 V specifications now available \*Comparison of AKZ439-047

■ The dimensions are the same as standard models, so no design changes are needed for different voltages.

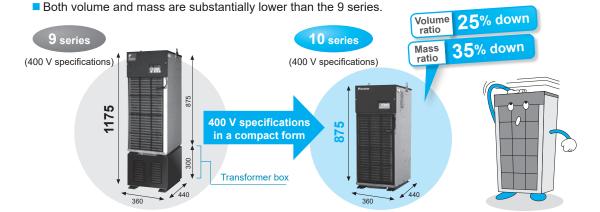

1 OIL COOLING UNIT


### **Features**

# Watch a video on the functions of Oil Cooling Units! URL https://www.hyd.daikin.com/my/oilcon functions

### Reliable in challenging factory environments


- The control panel ingress protection is equivalent to an IP54 rating.
- Electronic components resistant to sulfidation have been incorporated.
- The specifications for withstanding vibration during transport are matched to actual situations.

# Offering 6 types of standard option models in addition to the standard model to achieve short delivery

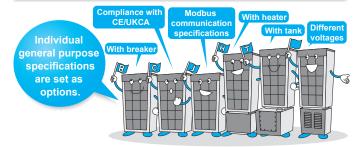

### Simple monitoring of the operating status

- The room temperature, inlet and outlet oil temperatures and other internal data can be monitored at a personal computer using Hybrid-Win\*. This data can be displayed collectively, making it easy to grasp the operating status.
- \* Hybrid-Win is utility software to monitor the internal status of DAIKIN hybrid systems using a PC. The software and its instruction manual can be downloaded from the website "https://www.hyd.daikin.com" free of charge by completing the user registration process.
- \* The communications cable and the monitor harness must be purchased separately.



### Superior functionality remains unchanged

Refrigerant gas shortage detection function
 When the refrigerant gas leak status occurs (cooling disabled), alarm signals are output.
 Prevents damage to the machine and machining defects.

■ Temperature warning function

A warning signal can be output when the targeted oil temperature or room temperature is out of the user-selected setting range.

Autotuning function

An autotuning function that automatically sets the control gain according to the system installed (tank oil volume, piping, etc.) greatly reduces adjustment time at the trial run.

■ 999-hour timer function (ON timer)


The operation start time can be set in a range between 0 and 999 hours (in hour units).


- Predictive maintenance function
- A warning signal is output to notify that maintenance is required when the air filter or condenser becomes clogged.
- When a thermistor fault (control failure) occurs, emergency operation is possible using another operation mode. This minimizes effects due to line stoppages.

### Easy to operate, and easy to maintain

- Easy-to-operate control panel that shows power consumption
- Plug-in terminal block makes tools unnecessary when connecting signals.
- Air filter structure that resists condenser clogging due to oil mist

### **Applications**

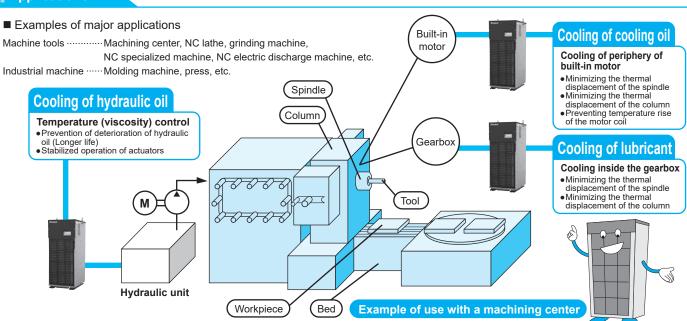

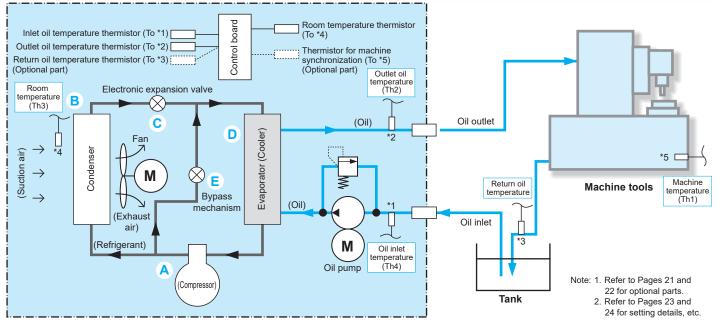


#### [Refrigerating cycle]

- A: Refrigerant gas is converted into compressed gas at high temperature and high pressure by a compressor so that gas can be easily cooled and liquefied by a condenser.
- **B**: In the condenser, the gas at high temperature and high pressure generated in the compressor is cooled with air and converted into liquid at high temperature and high pressure.
- C: The electronic expansion valve reduces the pressure of the liquid at high temperature and high pressure and converts it into liquid at low temperature and low pressure by throttling it so that it can be easily evaporated in a cooler.
- D: In the cooler, liquid at low temperature and low pressure generated in the electronic expansion valve absorbs heat from the oil, evaporates (cools the oil), and is converted into gas at low temperature and low pressure.
- E: The bypass mechanism controls the cooling capacity at low loads by adjusting the volume of gas at high temperature and high pressure supplied to the cooler.

## Piping System Diagram

OIL COOLING UNIT

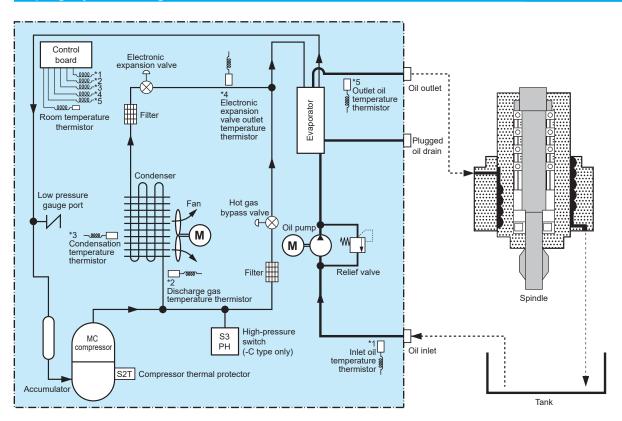

AKZ 14 A - \*\*\* \*\*

1 2 3 4 5

1 Oil cooling unit identification code

AKZ: High-accuracy inverter oil cooling unit [Circulating type, for cooling oil]

Cooling capacity (kW)

14: 1.4 kW 32: 3.2 kW 43: 4.3 kW 56: 5.6 kW 90: 9.0 kW

Symbol of series (Symbol to represent model change)

A: 10 series

4 Symbol of option type/Non-standard number

Options and their combinations (Refer to the following table.)

Special specifications (dual pumps, specified paint colors, etc.)

-\*\*\*(3-digit number), C\*\*\*(3-digit number), etc. Please consult us separately.
-500 indicates standard specifications (380 V/400 V/415 V)

5 Special specifications (specified packing specifications, communication options, etc.)

J: Communications option RS485/Modbus protocol

## Options and their combinations

### ■AKZ10 (Circulating type, for cooling oil)

Option symbol	With breaker	Compliance with CE/UKCA	With heater	With tank			Different voltage (3)
-В	0	_	_	-	-	_	-
-C	-	0	_	_	_	_	_
-H	-	_	0	-	-	_	_
-T	_	-	-	0	_	-	_
-046	-	_	_	-	0	_	-
-500	-	_	_	-	_	0	-
-048	0	_	-	-	_	_	0
-BC	0	0	-	_	_	_	_
–BH	0	_	0	-	_	_	_
–BT	0	-	-	0	_	-	_
-CH	-	0	0	-	_	_	_
-CT	ı	0	_	0	_	_	_
–HT	1	_	0	0	_	_	_
-BCH	0	0	0	-	_	_	_
-BCT	0	0	_	0	_	_	_
-BHT	0	_	0	0	_	_	_
-CHT	-	0	0	0	_	_	_
-BCHT	0	0	0	0	_	_	_
-001	0	_	_	-	0	_	_
-002	-	0	-	-	0	_	_
-003	-	_	0	-	0	_	_
-004	-	_	_	0	0	_	_
-005	0	0	_	_	0	_	_
-006	0	_	0	_	0	_	_
-007	0	-	_	0	0	_	_
-008	-	0	0	-	0	-	_
-009	-	0	_	0	0	-	_
-010	-	-	0	0	0	-	_
-011	0	0	0	-	0	-	_
-012	0	0	-	0	0	-	_
-013	0	_	0	0	0	_	_
-014	_	0	0	0	0	-	_
-015	0	0	0	0	0	_	_

	ption mbol	With breaker	Compliance with CE/UKCA	With heater	With tank	Different voltage (1)	Different voltage (2)	Different voltage (3)
В	500	0	_	_	_	_	0	-
C	500	_	0	_	_	_	0	_
Н	1500	_	_	0	_	-	0	_
Т	500	_	_	_	0	_	0	_
D	500	0	0	-	_	_	0	_
Е	500	0	_	0	_	_	0	_
G	500	0	_	_	0	_	0	_
K	500	_	0	0	_	_	0	_
N	1500	_	0	_	0	_	0	_
Ν	1500	_	_	0	0	_	0	_
Р	500	0	0	0	-	_	0	-
C	2500	0	0	-	0	_	0	-
R	2500	0	_	0	0	_	0	_
S	500	_	0	0	0	_	0	-
٧	′500	0	0	0	0	_	0	_
-	-032	0	0	_	_	_	_	0
-	-033	0	_	0	_	_	_	0
-	034	0	_	_	0	_	_	0
_	-038	0	0	0	_	_	_	0
_	-039	0	0	_	0	_	_	0
_	-040	0	-	0	0	_	-	0
_	044	0	0	0	0	_	_	0

# AKZ14A AKZ32A

	0.5						1.2 1.5												
Oil cooling unit hors	sepower (nP)	AKZ14A									AKZ							43A	
Model name		Stan- dard	-В -	-C -J	-H	-T	Different voltage	Stan- dard	-B -C	<b>-</b> J	-H	-T	Different voltage	Stan- dard	-B	_C -	-J -H	-T	Different voltage
Cooling capacity (50	0/60 Hz)*1 kW		+		1.3/	1 4	specifications*3				2.8/3	2	specifications*3				3.8/4	3	specifications*3
Heater (at 200 V)	kW				1.5/	1.4		$\vdash$	_		1	_			-		1	_	
Supply power*2	1000	Three	nh	200 /	C 200/200·22	N V 50/60 Hz	*3	Thre	a nhac	ωΔ	C 200/200·22	n V 50/60 Hz	*3	Thr	oo r	hace	AC 200/200·22	0 V 50/60 Hz	*3
NA - i	n circuit*3	THICC	, pii	iasc r	10 200/200 22	0 1 30/00 112	3	_	_			00/200-22		_	CC P	Лазс	AO 200/200 22	0 1 30/00 112	3
	erating circuit		+					_	mcc	ρı		2/24 V	0 1 30/00	112	H				
	200 V 50 Hz		+		0.90 kW/3.9	9 Δ				1	.36 kW/5.						1.80 kW/6.6	Δ	
neu	200 V 60 Hz				0.91 kW/3.		*11	⊢			.43 kW/5.		*11				1.88 kW/6.4		*11
Max. power	220 V 60 Hz		+	_	0.91 kW/3.			⊢		_	.43 kW/4.					_	1.88 kW/6.1		
consumption	200 V 50 Hz			Ť	1.29 kW/4.1 A	_				i	1.51 kW/5.4 A	_			-		1.51 kW/5.4 A	_	
When continguating	200 V 60 Hz				1.32 kW/4.2 A			$\vdash$			1.60 kW/5.4 A				-	_	1.60 kW/5.4 A	_	
When uondunsuos	220 V 60 Hz				1.55 kW/4.5 A	_		$\vdash$			1.83 kW/5.7 A				-		1.83 kW/5.7 A	_	
Transformer capac			+		-		2.6 kVA	$\vdash$					2.6 kVA				- 1.00 KV//0.77		2.6 kVA
Exterior color	nty						2.0 1071	_		l	vory white		2.0 1071		Н				2.0 1071
External dimensions (I	H v W v D) mm	650 x 3	360	× 440	950 × 360 × 440	810 × 360 × 465	950 × 360 × 440	775 >	360 × 4	_		965 × 360 × 465	1075 × 360 × 440	875	× 36	0 × 4	40 1175 × 360 × 440	1065 × 360 × 465	1175 × 360 × 440
Compressor (Hermetic		000 111	-	_	quivalent t		000 11 000 11 110	110				ent to 0.75		0.0	- 00			alent to 1.	
Evaporator	Do swiig type/		+		quivalent	O 0.4 KW					Cross-fin		7 100				Equiv	alone to 1.	
Condenser			+								Cross-fin								
Fan Motor			+								54				Н				
Motor			+								0.4 kW								
	e volume L/min		+		12/14	1 4					0.4 100	, A 41	24/	28.8					
Open pre			+		0.5			$\vdash$						.6					
-1 1			+				ure or ma	chin	e tem	ne	rature*4 (S	Set to "Roo			۵٠ ا	Mod	le 3" by defa	ault)	
ion State St	iect to be controlled		+			-				÷	,				_		by default)	auitj	
	chronization range °C		+				·					temperatu		_			, ,		
(Selectable)	ject to be controlled		+			0.		-	_	_		oil outlet			<i>y</i>	uon	auit)		
× € —	ange °C								.01 10		5 to		.oporate						
Refrigerant control	9		Ť		Rotation	speed con	trol of con	npre	ssor l	ογ			ate contro	ol of	ele	ctro	nic expans	on valve	
	amount kg		T		0.5			Ė		_	0.8						0.8		
R410A Carbor	n dioxide		T		1.1	3					1.7	n			Т		1.7	4	
(GWP: 2090) equival	lent tCO2eq		0	)verci			notor) rever	se-nh	ase nr	nte			ention timer	low	rooi	m te	mperature pro		nistor
Protection devices		cond		high ser th	oil temperat nermistor, refi	ure protectio	n thermistor age detector	low o	oil tem of inve	per rter	ature protection of	tion thermisted	or, relief valv -pressure sv	/e (fo vitch	ra (–C	pum type	p), discharge per only), compre cuit breaker (-	pipe thermist essor therma	or,
Room te	mperature °C		T	Ť	romout prot	ootion tompo	rataro omito	. (	ijpo i	,	5 to		(Jpo	Jy ):	,	u o	out broundry	o type emy/	
	emperature °C		Ť								5 to								
Operating Oil visco	· .		Ť						1	.4	to 200 (IS	O VG2 to	32)		Н				
range	Discharge side		T								0.5 MPa r				Н				
pressure	Suction side		T							No	lower tha	n –30.7 kF	Pa						
			L	ubri	cating oil, i	mineral oil	based hy	drau		_				Iraul	ic c	oil, v	vater, water	-soluble li	quid,
Acceptable oils							chemicals	, foc	od pro	οdι	ıcts, fuel,	cutting flui	d, grinding	g flui	id,	etc.	)		
	Oil inlet										Rc3	/4							
Connecting C	il outlet	Ro	:3/	4	Rc1 1/4	Ro	3/4	R	c3/4		Rc1 1/4	Rc	3/4	R	c3	/4	Rc1 1/4	Rc	3/4
									Ro	1/4 (Plug	ged)								
Noise level (value equivalent to measurement in an anechoic chamber) (Front 1 m, height 1.55 m) dB (A) <sup>s</sup>				65	5														
Permissible transp	ort vibration*7						Up and	d dov	vn vil	ora	tion 14.7	$m/s^2 \times 2.5$	hr (7.5 to	100	Hz	z sw	eep/five mi	n.)	
Ingress protection			I								IP2)	<b>C</b> *8							
Mass	kg		57		83	77	93		63		89	83	99		65	_	95	82	103
In-machine circuit breake	r (rated current) A	- 1	0			-		-	10			-		-	10			-	
Oil tank (Capacity)				-		15 <sup>*9</sup>	-			-		20*9	-				-	20 <sup>*9</sup>	-
Items Earth leakage prepared by the customer (Rated current)*10 A											10	)							

- The cooling capacity indicates the value at the standard point (inlet oil temperature: 35°C, room temperature: 35°C, oil used: ISO VG32, 1 atm). This unit has about ±5% of product tolerance.

  Use a commercial power supply for the power source. The use of an inverter power supply may cause burn damage to the
  - oil cooling unit. The voltage fluctuation range should be within  $\pm 10\%$ . If it is more than  $\pm 10\%$ , please consult us.
  - There are three types of different voltage specifications depending on the power source: -046, -048 and -500 units. -048 units deal with the different voltage by featuring a transformer.

    When equipped with a transformer, the main circuit voltage is the transformer's secondary side voltage of AC 200 V, 50/60 Hz
    - (-046 units and -500 units have no transformer and therefore have the same external dimensions and mass as standard units. Their main circuit voltage is AC 220/230 V, 50/60 Hz for -046 units and AC 380/400/415 V, 50/60 Hz for -500 units.). The machine temperature synchronization thermistor available as an option is required for this function. (Refer to Page 21 for details.)

  - The refrigerant is enclosed in a sealed container. The SDS (Safety Data Sheet) for R410A refrigerant is provided with to -C type units. The rotational speed of the fan motor varies depending on the room temperature to conserve energy. Therefore, it is normal for
  - the noise level to vary accordingly.

    The specifications for permissible transport vibration are those of a standard unit.
  - Electric component section ingress protection: IP54 or equivalent (However, use piping conduits etc. rated at least IP54 at wiring ports.)

  - \*9. The yellow line on the tank oil level gauge shows the highest oil level and the red line the lowest oil level.
    \*10. The earth leakage breaker is not supplied with this product. Please prepare it yourself.
    \*11. The maximum power consumption/maximum current consumption of different voltage specifications are shown in the tables below. (For -500 units, refer to pages 7 and 8.)

AKZ14A		AKZ32A		<ul><li>AKZ43A</li></ul>		AKZ56A		AKZ90A	
Supply power	Power/current	Supply power	Power/current	Supply power	Power/current	Supply power	Power/current	Supply power	Power/current
220 V	0.91 kW 3.6 A	220 V	1.43 kW 4.8 A	220 V	1.88 kW 6.0 A	220 V	2.30 kW 7.3 A	220 V	4.30 kW 13.0 A
230 V	0.91 kW 3.4 A	230 V	1.43 kW 4.6 A	230 V	1.88 kW 5.8 A	230 V	2.30 kW 7.0 A	230 V	4.30 kW 12.4 A
440 V 50/60 Hz	0.92 kW 1.8 A	440 V 50/60 Hz	1.45 kW 2.4 A	440 V 50/60 Hz	1.90 kW 3.0 A	440 V 50/60 Hz	2.32 kW 3.5 A	440 V 50/60 Hz	4.33 kW 6.2 A
460 V	0.92 kW 1.7 A	460 V	1.45 kW 2.3 A	460 V	1.90 kW 2.9 A	460 V	2.32 kW 3.3 A	460 V	4.33 kW 5.9 A
480 V	0.92 kW 1.7 A	480 V	1.45 kW 2.2 A	480 V	1.90 kW 2.8 A	480 V	2.32 kW 3.2 A	480 V	4.33 kW 5.7 A

# AKZ56A AKZ90A

Oil cooling	unit horsepower (HP)					2.0						3.0		
						AKZ	56A					AKZ	90A	1
Model nam	ne	Stan- dard	-В	-C	–J	–H	-T	Different voltage specifications*3	Stan- dard	-В -	-C  -J	-Н	-T	Different voltage specifications*3
Cooling cap	pacity (50/60 Hz)*1 kW					5.0/5	.6					8.0/9	.0	
Heater (at 2	200 V) kW		-	-		2	_			-		3	-	
Supply power*2		T	hree	pha	se A	C 200/200·220	V 50/60 Hz	*3	Т	hree p	hase.	AC 200/200·220	V 50/60 Hz	*3
Circuit Main circuit*3							Th	ree phase AC	200/:	200-22	20 V 50	0/60 Hz		
voltage	Operating circuit							DC	12/2	4 V				
	⊕ E 200 V 50 Hz					2.22 kW/7.6 A						4.25 kW/13.5 A		
Max. power						2.30 kW/7.5 A		*11				4.30 kW/13.4 A		*11
consumption	n_ > 8 220 V 60 Hz					2.30 kW/7.2 A						4.30 kW/12.9 A		
Max. curren consumption	200 V 50 Hz		-	-		2.59 kW/9.3 A				_		3.64 kW/12.4 A	_	
consumption	200 V 60 Hz 200 V 60 Hz		-	-		2.68 kW/9.0 A				_		3.73 kW/12.2 A	_	
	≤ ½ 220 V 60 Hz		-	-		3.11 kW/9.7 A	_			_		4.37 kW/13.2 A	_	
Transforme	er capacity					_		4.0 kVA				_		6.0 kVA
Exterior col	lor							lvory white	Э					
External dime	ensions (H × W × D) mm	111	0 × 4	70 ×	500	1410 × 470 × 560	1375 × 470 × 580	1360 × 470 × 590	122	0 × 560	0 × 620	1520 × 560 × 680	1485 × 560 × 700	1470 × 560 × 695
Compressor (	(Hermetic DC swing type)					Equiva	elent to 1.5 kW					Equiva	alent to 2.2 kW	
Evaporator	f							Brazed p	late	type				
Condenser	r							Cross-fin	coil	type				
Fan	Motor							100	W					
	Motor							0.7 kV	V × 4	ŀΡ				
Oil pump	Discharge volume L/min							30	/36					
	Open pressure MPa							0	.6					
					R	loom temperatu	re or machine	temperature*4 (	Set t	o "Roc	om ten	perature: Mode	3" by default)	
Temperature	Object to be controlled										_	t temperature b		
control	Standard  Object to be controlled  Synchronization range °C											at 0.0 by defau	, ,	
						0.0		temperature o				-	,	
	Object to be controlled Range °C								50					
Refrigerant				F	Rotati	ion speed contr	ol of compress			ening r	ate co	ntrol of electron	ic expansion va	lve
Refrigerant:	Filling amount kg					1.02		o. 27	O p c	,,,,,,g .	410 00	1.3		
R410A	Carbon diavida													
(GWP: 2090)	) <sup>5</sup> equivalent tCO <sub>2</sub> eq		_			2.14						2.8		
												imer, low room tem f valve (for a pump		
Protection	devices	cor		er the	rmisto	or, refrigerant leaka	ge detector, set of	inverter protection	devi	ces, high	h-pressi	re switch (-C type	only), compressor	thermal protector,
	70 cm tomoroutum °0			OV	ernea	t protection tempe	rature switch (-H t	11		tion swi	tcn (-H	type only), and circ	uit breaker (-B type	e only)
_	Room temperature °C								45					
_	Oil inlet temperature °C								50	00.4-	20)			
	Dil viscosity mm²/s External Discharge side							1.4 to 200 (IS			32)			
р	pressure							0.5 MPa						
lc	oss Suction side					21 2 1 21		No lower tha						
Acceptable	oils		Lul	DLICE	ung							hydraulic oil, wa ding fluid, etc.)	ater, water-solu	bie iiquid,
	Oil inlet			B	c1 1		Rc1	Rc1 1/4		J	Rc1		Rc1	Rc1 1/4
Connecting									1/4					
tube Oil drain								Rc1/4 (I		ned)				
Noise level (value equivalent to								110174 (1	lug	gou)				
measurement	t in an anechoic chamber)					65						67		
	(Front 1 m, height 1.55 m) dB (A) <sup>16</sup> Permissible transport vibration <sup>17</sup>					I In and	l down vibratio	14.7 m/s <sup>2</sup> v 2	5 hr	(7.5.±	100	Iz sweep/five m	in )	
Permissible transport vibration / Ingress protection						op and	a down vibration		Σ*8	(7.5 10	1001	ı∠ əweep/iive III	)	
			8	6		120	110	149	^ -	104	1	145	120	100
Mass In machine circu	kg		15	U		120	119	149	_		•	145	139	182
	uit breaker (rated current) A	-	15		_				$\vdash$	20			70*9	_
Oil tank (Ca	· · · · · · · · · · · · · · · · · · ·				_		50*9	-	_		-		70 <sup>*9</sup>	_
Items Earth leakage prepared by breaker						1	5					2	0	
the custome	the customer (Rated current)*10 A								<u> </u>					


Refer to Page 5 for explanatory notes.

# Operating range

Note: 1. The " $\bigcirc$ " symbol indicates the standard point.

2. Be sure to use the unit within the range of use specified in \_\_\_\_\_\_.

(Use outside this range may cause unit failure.)



## AKZ14A-500 AKZ32A-500 AKZ43A-500

Oil cooling un	it horsepower (HP)				0.5					1.2		1.5				
Model name				P	KZ14A-500				Д	KZ32A-500				Α	KZ43A-500	
Woder Hame		Standard	В	С	Н	Т	Standard	В	С	Н	Т	Standard	В	С	Н	Т
Cooling capac	city (50/60 Hz)*1 kW				1.3/1.4					2.8/3.2					3.8/4.3	
Heater (at 40	0 V) kW		-		1	-		-		1	-		-		1	-
Supply power	r* <sup>2</sup>						Three	e pha	se A	C 380/400/41	5 V 50/60 Hz					
Circuit	Main circuit						Three	e pha	se A(	380/400/41	5 V 50/60 Hz					
voltage	Operating circuit								1	DC 12/24 V						
	드 한 <u>380 V 50/60 Hz</u>			1	.01 kW/2.3 A				1.	.59 kW/3.1 A				1.	99 kW/3.6 A	
Max. power	Help 380 V 50/60 Hz 400 V 50/60 Hz 415 V 50/60 Hz			1	.02 kW/2.2 A				1.	.60 kW/3.0 A				1.	99 kW/3.5 A	
consumption	415 V 50/60 Hz			1	.03 kW/2.2 A				1.	.60 kW/2.9 A				2.	00 kW/3.4 A	
Max. current consumption	_ p 380 V 50/60 Hz		-		1.70 kW/2.7 A	-		-		1.75 kW/2.8 A	-		-		1.75 kW/2.8 A	-
consumption	Media = 380 V 50/60 Hz 400 V 50/60 Hz 415 V 50/60 Hz		-		1.80 kW/2.7 A	-		-		1.85 kW/2.8 A	-		-		1.85 kW/2.8 A	-
	> = 415 V 50/60 Hz		-		1.91 kW/2.8 A	-		-		1.96 kW/2.9 A	-		-		1.96 kW/2.9 A	-
Exterior color	•									Ivory white						
External dimens	sion $(H \times W \times D)$ mm	650 >	< 360 >	440	950 × 360 × 440	810 × 360 × 535	775 ×	360	× 440	1075 × 360 × 440	965 × 360 × 535	875 >	360	× 440	1175 × 360 × 440	1065 × 360 × 535
Compressor (He	ermetic DC swing type)			Equi	valent to 0.4 I	κW		-	Equiv	alent to 0.75	kW			Equiv	alent to 1.1 l	¢W
Evaporator									Cro	ss-fin-coil typ	е					
Condenser									Cro	ss-fin-coil typ	е					
Propeller fan	Motor				φ240, 54 W						ф300,	54 W	1			
М	otor								0	.4 kW × 4 P						
Oil pump Di	scharge volume L/min				12/14.4						24/	28.8				
O	pen pressure MPa				0.5						0	.6				
ation	Standard		Room temperature or machine temperature*3 (Set to "Room temperature: Mode 3" by default)													
Temperature Control	Object to be controlled				Oil inlet	temperature	or oil	outle	t tem	perature (Set	to oil inlet te	mpera	ature	by de	fault)	
Temperature control	Synchronization range °C					-9.9 to +9.9 a	gains	t the	refer	ence tempera	ature (Set at 0	0.0 by	defa	ult)		
	Object to be controlled					O	il inle	t tem	perat	ure or oil outl	et temperatu	re				
(Selectable) Selectable	₹ Range °C									5 to 50						
Refrigerant co	ontrol			Ro	otation speed	control of cor	mpres	ssor b	y inv	erter + Openi	ng rate contr	ol of e	electri	іс ехр	ansion valve	
Refrigerant:	Filling amount Kg				0.54					0.81					0.83	
R410A (GWP: 2090) <sup>-4</sup>	Carbon dioxide equivalent tCO2eq				1.13					1.70					1.74	
Protection de	vices	cond	hig	h oil te therm	mperature prote istor, refrigerant	np motor), reversection thermistor, leakage detector temperature swit	low oil	tempo finver	erature ter pro	e protection therr tection devices,	nistor, relief valv high-pressure s\	e (for a witch (0	a pump C type	o), disc only),	harge pipe then compressor then	mistor, mal protector,
Rooi	m temperature °C									5 to 45						
Oil ir	nlet temperature °C									5 to 50						
Operating Oil v	riscosity mm²/s							1.4	to 20	00 (ISO VG2	to 32)					
range Exte									0.5	MPa maximu	m					
loss	Suction side									er than –30.7						
Acceptable of		Lubrio	ating oi	l, miner	al oil based hydrau	ılic oil (except for p	hosphat	te ester	hydrau		-soluble liquid, che	micals,	food pr	oducts,	fuel, cutting fluid, o	rinding fluid, etc.)
Connecting	Oil inlet									Rc3/4						
tube	Oil outlet		Rc3/4		Rc1 1/4	R	c3/4			Rc1 1/4	R	c3/4			Rc1 1/4	Rc3/4
	Oil drain								Rc	1/4 (Plugged	)					
measurement in	Noise level (value equivalent to measurement in an anechoic chamber) (Front 1 m, height 1.55 m) dB (A)*5					6	2								65	
Permissible to	ransport vibration⁴6				Uį	and down v	bratio	n 14	.7 m/s	$s^2 \times 2.5 \text{ hr } (7.$	5 to 100 Hz s	weep	/five	min.)		
Ingress prote	ction									IP2X*7						
Mass	kg		57		87	77		63		93	83		67		97	87
Internal molded-case ci	ircuit breaker (Rated current) A	-	10		-		-	10		-		-	10		-	
Oil tank (Cap	acity) L			-		15 <sup>*8</sup>			-		20 <sup>*8</sup>			-		20*8
Items prepared by the customer	Earth leakage breaker (Rated current)" A									10						

- Note: \*1. The cooling capacity indicates the value at the standard point (inlet oil temperature: 35°C, room temperature: 35°C, oil used: ISO VG32, 1 atm). This unit has about ±5% of product tolerance.

  - \*2. Use a commercial power supply for the power source. The use of an inverter power supply may cause burn damage to the oil cooling unit.
    \*3. The machine temperature synchronization thermistor available as an option is required for this function. (Refer to Page 21 for details.)
  - \*4. The refrigerant is enclosed in a sealed container. The SDS (Safety Data Sheet) for R410A refrigerant is provided with to C
  - type units.

    \*5. The rotational speed of the fan varies depending on the room temperature to conserve energy. Therefore, it is normal for the noise level to vary accordingly.

    \*6 The specifications for permissible transport vibration are those of a standard unit.

    \*7. Electric component box ingress protection: IP54 or equivalent (However, use piping conduits etc. rated at least IP54 at wiring ports.)

    \*8. The yellow line on the tank oil level gauge shows the highest oil level and the red line the lowest oil level.

    \*9. The earth leakage breaker is not supplied with this product. Please prepare it yourself.

# AKZ56A-500 AKZ90A-500

Oil cooling ur	nit horsepower (HP)				2.0					3.0	
Model name					AKZ56A-500					AKZ90A-500	
Wodel Hairie		Standard	В	С	Н	Т	Standard	В	С	Н	Т
Cooling capa	city (50/60 Hz)*1 kW				5.0/5.6					8.0/9.0	
Heater (at 40	00 V) kW		-		2	-		-		3	_
Supply powe	r*2				-	Three phase AC 380	/400/41	5 V 50/6	0 Hz		
Circuit	Main circuit				7	Three phase AC 380	/400/41	5 V 50/6	0 Hz		
voltage	Operating circuit					DC 12	2/24 V				
	50 € 380 V 50/60 Hz				2.49 kW/4.6 A					4.39 kW/8.4 A	
Max. power	9 400 V 50/60 Hz				2.54 kW/4.6 A					4.42 kW/8.2 A	
consumption	> 8 415 V 50/60 Hz				2.54 kW/4.5 A					4.38 kW/8.1 A	
Max. current	_ <u>⊅</u> 380 V 50/60 Hz		-		2.44 kW/4.3 A	-		-		3.43 kW/5.8 A	_
consumption	Media = 380 V 50/60 Hz 400 V 50/60 Hz 415 V 50/60 Hz		-		2.64 kW/4.6 A	-		-		3.74 kW/6.2 A	-
	≤ <u>2</u> 415 V 50/60 Hz		-		2.80 kW/4.8 A	-		-		3.98 kW/6.4 A	-
Exterior colo	r					Ivory	white				
External dimen	nsion (H × W × D) mm	1110	× 470 >	500	1410 × 470 × 560	1375 × 470 × 580	1220	× 560 >	620	1520 × 560 × 680	1485 × 560 × 700
Compressor (He	ermetic DC swing type)			Ed	uivalent to 1.5 kW				E	quivalent to 2.2 kW	
Evaporator						Brazed p	late typ	е			
Condenser						Cross-fin	-coil typ	е			
Propeller fan	Motor				φ400, 100 W					φ455, 100 W	
N	lotor					0.7 kV	V × 4 P				
Oil pump D	ischarge volume L/min					30	/36				
0	pen pressure MPa					0	.6				
tio	Standard			Room t	emperature or mac	hine temperature*3 (	Set to "F	Room te	mperatı	ure: Mode 3" by defa	ult)
Şezille Temperature	S Object to be controlled			Oi	inlet temperature o	r oil outlet temperat	ure (Set	to oil in	let temp	perature by default)	,
control				-9.9 to +9.9 ag	gainst the reference	tempera	ture (Se	et at 0.0	by default)		
(Selectable)					Oi	inlet temperature o	r oil outl	et temp	erature	,	
Hixed bearing	Object to be controlled Range °C					5 to	50				
Refrigerant of			Ro	otation s	peed control of com	pressor by inverter	+ Openi	ng rate	control	of electric expansion	n valve
	Filling amount Kg				1.02	, ,		<u> </u>		1.37	
R410A (GWP: 2090)*4	Carbon dioxide				-						
(0111 : 2000)	equivalent tCO2eq				2.14					2.87	
Protection de			high oil te ser therm	emperatur istor, refri	e protection thermistor, I gerant leakage detector,	e-phase protection device ow oil temperature prote set of inverter protection th (H type only), oil lack p	ction therr devices, protection	nistor, reli high-pres	ef valve ( sure swite	for a pump), discharge p ch (C type only), compre	ipe thermistor, ssor thermal protector,
	om temperature °C						45				
Operating —	inlet temperature °C						50				
range Oil	viscosity mm <sup>2</sup> /s					1.4 to 200 (IS		,			
	ernal Discharge side					0.5 MPa					
loss	Suction side					No lower that					
Acceptable of		Lubricatin	g oil, mine			osphate ester hydraulic oil, v	vater, water	-soluble liq			ng fluid, grinding fluid, etc.)
Connecting	Oil inlet			Rc11	/4	Rc1			Rc11	/4	Rc1
Connecting tube	Oil outlet					Rc	11/4				
	Oil drain					Rc1/4 (F	lugged	)			
	ue equivalent to n an anechoic chamber) ht 1.55 m) dB (A)*5				65					67	
Permissible t	ransport vibration*6				Up and down vib	oration 14.7 m/s $^2 \times 2$	.5 hr (7.	5 to 100	Hz sw	eep/five min.)	
Ingress prote	ection					IP2	2X*7				
Mass	kg		86		120	119		104		145	139
Internal molded-case of	circuit breaker (Rated current) A	-	15		-		-	20		-	
Oil tank (Cap	pacity) L			-		50*8			-		70*8
Items prepared by the customer	Earth leakage breaker (Rated current) <sup>19</sup> A				15					20	


Refer to Page 7 for explanatory notes.

# Operating range


Note: 1. The mark "O" shows the standard point.

2. Be sure to use the unit within the range of use specified in \_\_\_\_\_\_.


(Use outside this range may cause unit failure.)




### **AKZ14A**

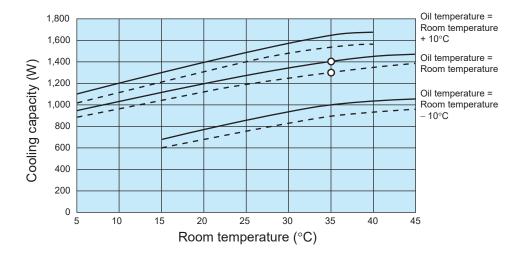


### AKZ32A

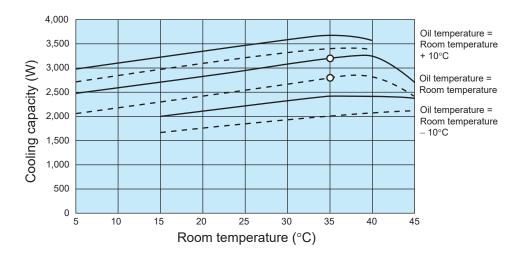


### AKZ43A

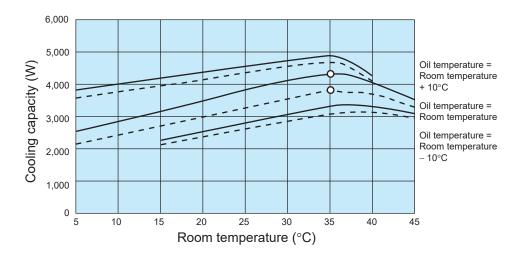

### **AKZ56A**

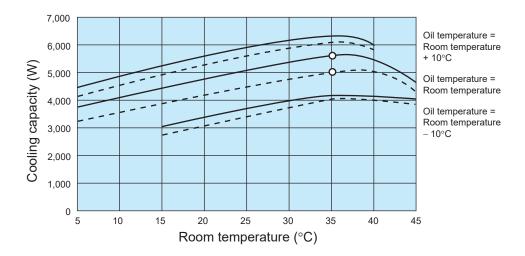


### AKZ90A

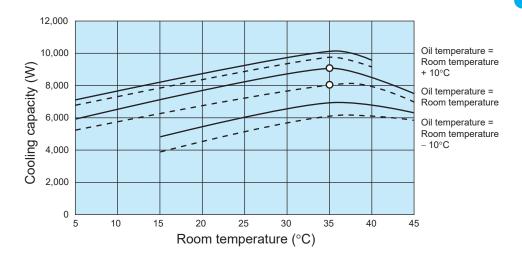



■Solid line —— : When operated at 60 Hz ■Broken line - - - : When operated at 50 Hz

- The mark "O" shows the standard point.
   (Room temperature: 35°C/Oil inlet temperature: 35°C/Oil used: ISO VG32)
- 2. The cooling capacity varies depending on conditions such as the room temperature, oil inlet temperature, oil dynamic viscosity and other factors.


## AKZ14A (-B, -C, -046, -500) Standard specifications With breaker Compliance with CE/UKCA Transformerless 400 V specifications

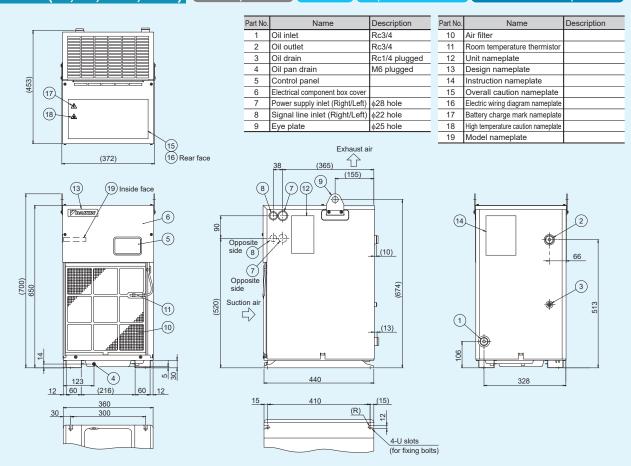

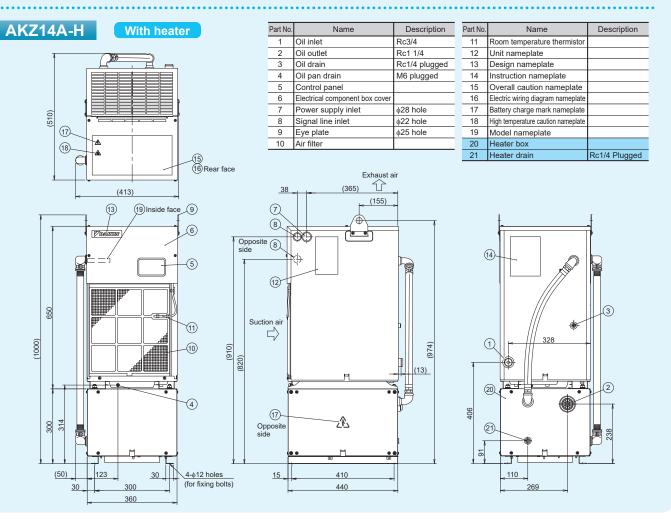

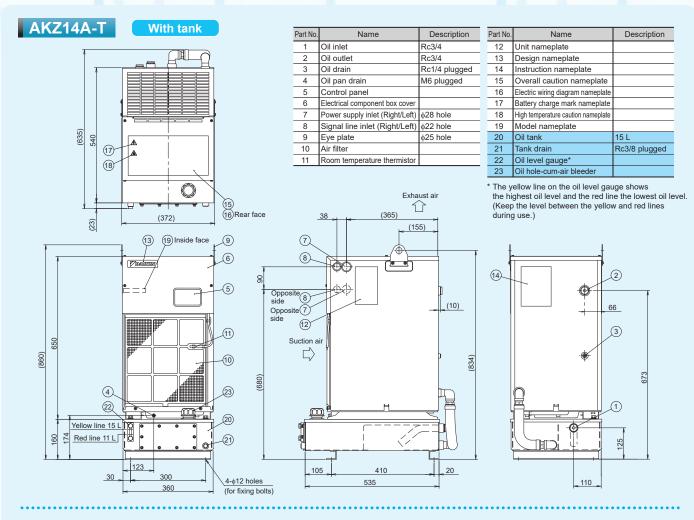








Part No.	Name	Description
1	Oil inlet	Rc3/4
2	Oil outlet	Rc3/4
3	Oil drain	Rc1/4 plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet (Right/Left)	φ28 hole
8	Signal line inlet (Right/Left)	φ22 hole
9	Hanger	φ25 hole
10	Air filter	


Рап №.	Name	Description
11	Room temperature thermistor	
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	
20	Transformer	
21	Transformer box	
	<u> </u>	




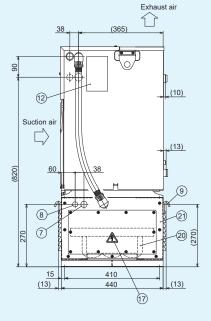




# AKZ32A (-B, -C, -046, -500) Standard specifications With breaker Compliance with CE/UKCA Transformerless 400 V specifications

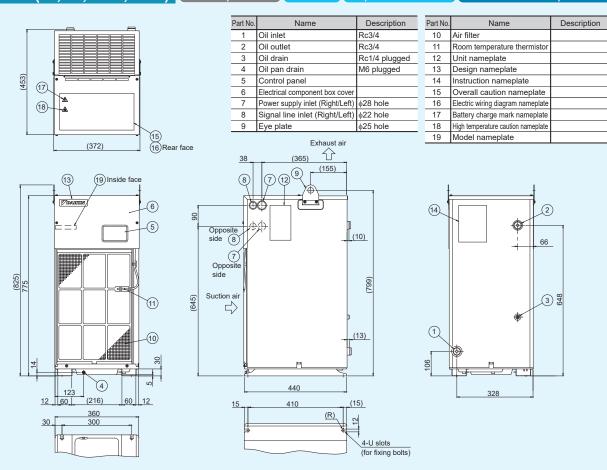

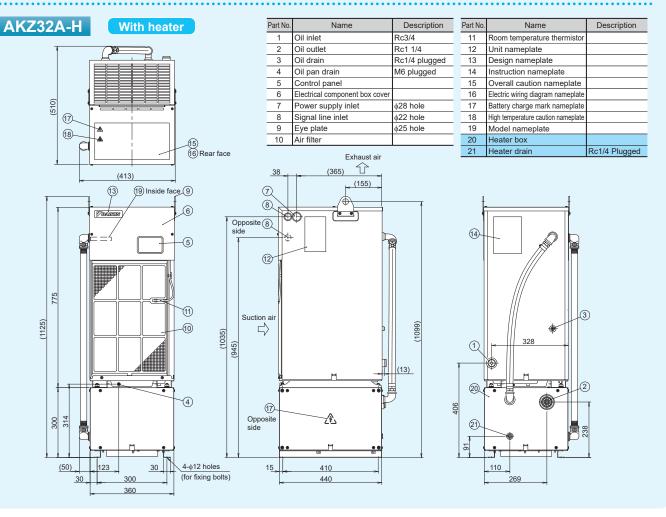


# AKZ32A-T With tank





Part No.	Name	Description
1	Oil inlet	Rc3/4
2	Oil outlet	Rc3/4
3	Oil drain	Rc1/4 Plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet (Right/Left)	φ28 hole
8	Signal line inlet (Right/Left)	φ22 hole
9	Eye plate	φ25 hole
10	Air filter	
11	Room temperature thermistor	

n	Part No.	Name	Description
	12	Unit nameplate	
	13	Design nameplate	
i	14	Instruction nameplate	
	15	Overall caution nameplate	
	16	Electric wiring diagram nameplate	
	17	Battery charge mark nameplate	
	18	High temperature caution nameplate	
	19	Model nameplate	
	20	Oil tank	20 L
	21	Tank drain	Rc3/8 plugged
	22	Oil level gauge*	
	23	Oil hole-cum-air bleeder	
	* The v	ellow line on the oil level gar	ine shows

\* The yellow line on the oil level gauge shows the highest oil level and the red line the lowest oil level. (Keep the level between the yellow and red lines during use.)

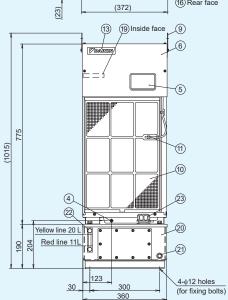


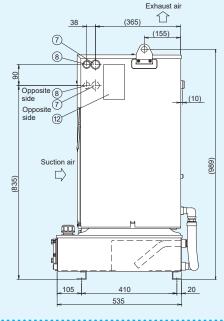



# AKZ32A-048 Different voltages (With transformer)


(F) (F)

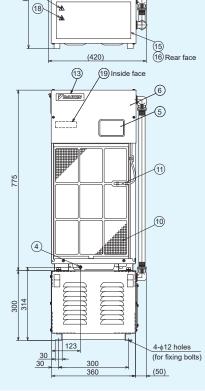


i aitivo.	INGILIC	Description
1	Oil inlet	Rc3/4
2	Oil outlet	Rc3/4
3	Oil drain	Rc1/4 plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet (Right/Left)	φ28 hole
8	Signal line inlet (Right/Left)	φ22 hole
9	Hanger	φ25 hole
10	Air filter	


	10 Air filter		
06	38	(365) Exh	aust air
(945)	Suction air	38	(10) (13) (13) (21) (20) (22)
	15 (13)	410 440	(13)
		17	)

Part No.	Name	Description
11	Room temperature thermistor	
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	
20	Transformer	
21	Transformer box	

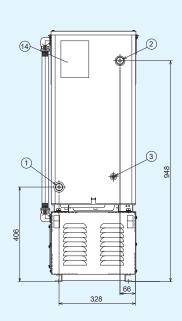

# AKZ43A (-B, -C, -046, -500) Standard specifications With breaker Compliance with CE/UKCA Transformerless 400 V specifications

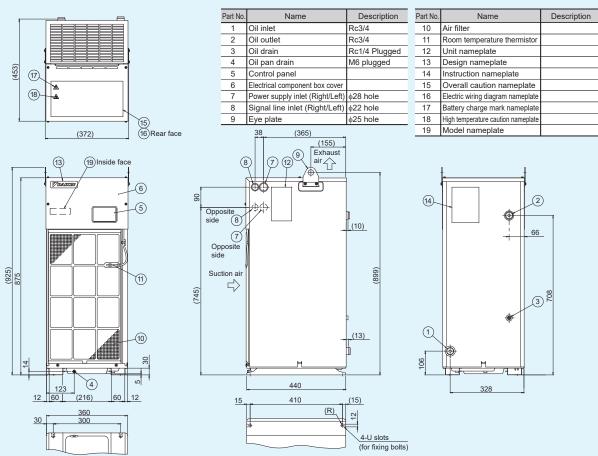


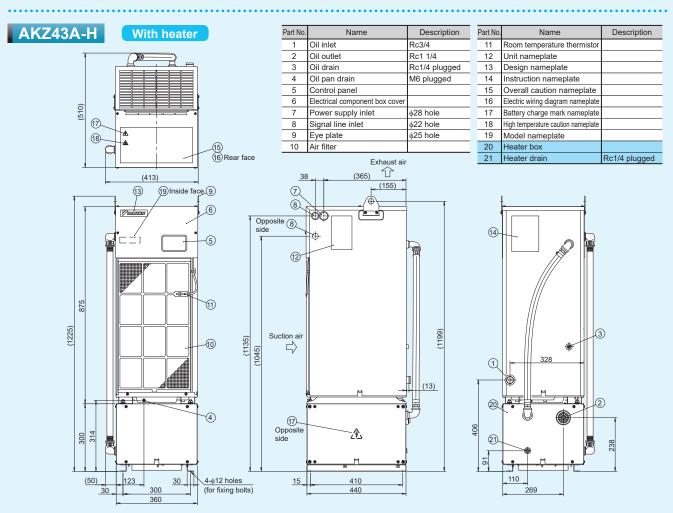

3

1

155

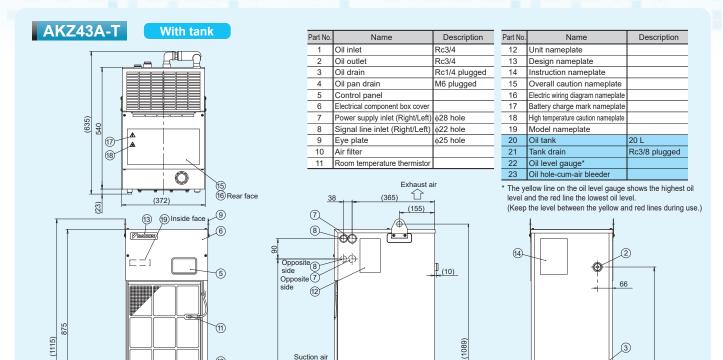

Suction air

1001

105

410

20

(932)

-10)

-20

-(21)

4-φ12 holes


(4)

22


Yellow line 20 L

Red line 11 L


123

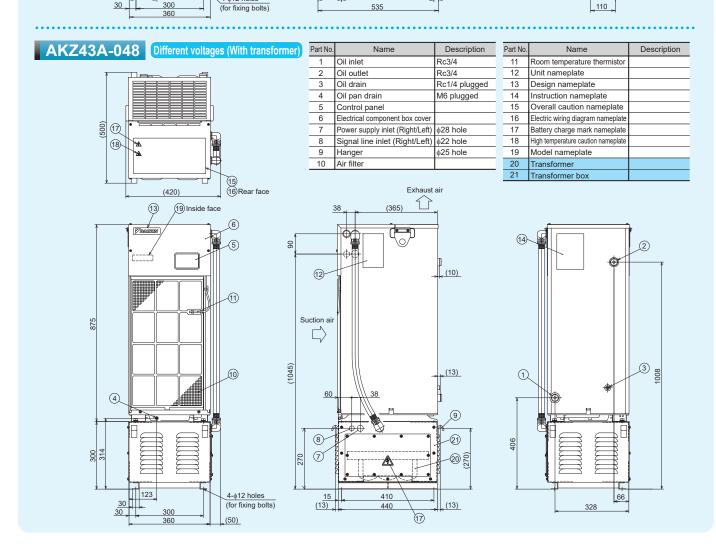


# AKZ56A (-B, -C, -046, -500) Standard specifications With breaker Compliance with CE/UKCA Transformerless 400 V specifications

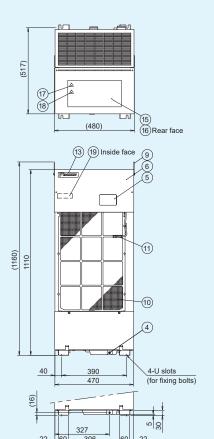

Part No.	Name	Description
1	Oil inlet	Rc1 1/4
2	Oil outlet	Rc1 1/4
3	Oil drain	Rc1/4 plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet (Right/Left)	φ28 hole
8	Signal line inlet (Right/Left)	φ22 hole
9	Eye plate	φ25 hole
20 (405)		

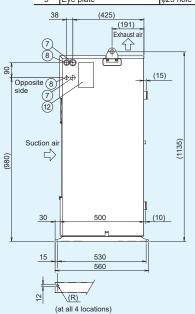


Part No.	Name	Description
10	Air filter	
11	Room temperature thermistor	
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	



# AKZ56A-H

(212)


### With heater

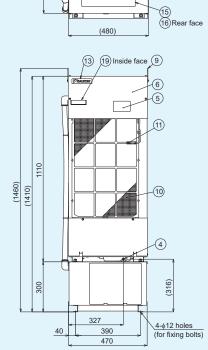

Part No.	Name	Description	
1	Oil inlet	Rc1 1/4	
2	Oil outlet	Rc1 1/4	
3	Oil drain	Rc1/4 plugged	
4	Oil pan drain	M6 plugged	
5	Control panel		
6	Electrical component box cover		
7	Power supply inlet	φ28 hole	
8	Signal line inlet (Right/Left)	φ22 hole	
9	Eye plate	φ25 hole	
10	Air filter		
	Exhaust air		


(1370)	(1280)	Opposite 8.  12  Suction a	(1435)
		Opposite	(10)
,	, ,	,	<u>*</u>
		<u>15</u>	530 560

Part No.	Name	Description
11	Room temperature thermistor	
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	
20	Heater box	
21	Heater drain	Rc1/4 Plugged

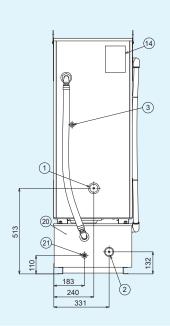


# AKZ56A-T


### With tank




Part No.	Name	Description
1	Oil inlet	Rc1
2	Oil outlet	Rc1 1/4
3	Oil drain	Rc1/4 plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet (Right/Left)	φ28 hole
8	Signal line inlet (Right/Left)	φ22 hole
9	Eye plate	φ25 hole
10	Air filter	
11	Room temperature thermistor	

Part No.	Name	Description
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	
20	Oil tank	50 L
21	Tank drain	Rc3/8 plugged
22	Oil level gauge*	
23	Oil hole-cum-air bleeder	

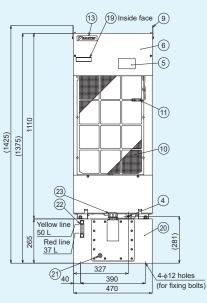


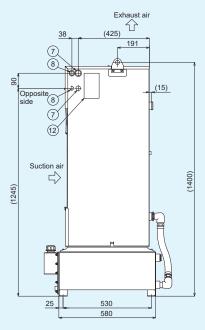

\* The yellow line on the oil level gauge shows the highest oil level and the red line the lowest oil level. (Keep the level between the yellow and red lines during use.)





# AKZ56A-048 Different voltages (With transformer)




Part No.	Name	Description
1	Oil inlet	Rc3/4
2	Oil outlet	Rc3/4
3	Oil drain	Rc1/4 plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet (Right/Left)	φ28 hole
8	Signal line inlet (Right/Left)	φ22 hole
9	Hanger	φ25 hole
10	Air filter	


Part No.	Name	Description
11	Room temperature thermistor	
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	
20	Transformer	
21	Transformer box	




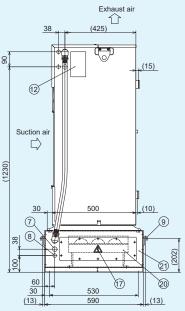





# AKZ90A (-B, -C, -046, -500) Standard specifications With breaker Compliance with CE/UKCA Transformerless 400 V specifications






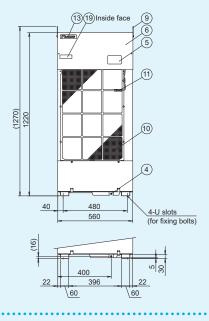

Name	Description
Oil inlet	Rc1 1/4
Oil outlet	Rc1 1/4
Oil drain	Rc1/4 plugged
Oil pan drain	M6 plugged
Control panel	
Electrical component box cover	
Power supply inlet (Right/Left)	φ28 hole
Signal line inlet (Right/Left)	φ22 hole
Eye plate	φ25 hole
	Oil inlet Oil outlet Oil drain Oil pan drain Control panel Electrical component box cover Power supply inlet (Right/Left) Signal line inlet (Right/Left)

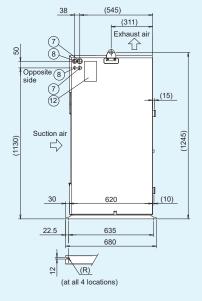


Part No.	Name	Description
10	Air filter	
11	Room temperature thermistor	
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	



# AKZ90A-H

### With heater



				(13) (19) Inside fac	ж <u>9</u>
(1570)	(1520)	1220			
	, ,	300	,		(316)
400 4-∳12 holes (for fixing bolt					

Part No.	Name	Description
1	Oil inlet	Rc1 1/4
2	Oil outlet	Rc1 1/4
3	Oil drain	Rc1/4 plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet	φ28 hole
8	Signal line inlet	φ22 hole
9	Eye plate	φ25 hole
10	Air filter	


		3 <u>3</u> (7) (8)	Exhaust air (545) (311)	
(1480)	(1430)	Opposite 8 side 12		(1545)
		Opposite side 17	620 (11	<u>D)</u>

635

680


22.5

Part No.	Name Description	
11	Room temperature thermistor	
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	
20	Heater box	
21	Heater drain	Rc1/4 Plugged



# AKZ90A-T

### With tank



Part No.	Name	Description
1	Oil inlet	Rc1
2	Oil outlet	Rc1 1/4
3	Oil drain	Rc1/4 plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet (Right/Left)	φ28 hole
8	Signal line inlet (Right/Left)	φ22 hole
9	Eye plate	φ25 hole
10	Air filter	
11	Room temperature thermistor	


Part No.	Name	Description
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	
20	Oil tank	70 L
21	Tank drain	Rc3/8 plugged
22	Oil level gauge*	
23	Oil hole-cum-air bleeder	

(1892) (1386) (1486) (1


400

480

560



The yellow line on the oil level gauge shows the highest oil level and the red line the lowest oil level. (Keep the level between the yellow and red lines during use.)



# AKZ90A-048

265

Yellow line 70 L Red line 51 L

21)


40

### Different voltages (With transformer)

(28)


4-φ12 holes


(for fixing bolts)




Part No.	Name	Description
1	Oil inlet	Rc3/4
2	Oil outlet	Rc3/4
3	Oil drain	Rc1/4 plugged
4	Oil pan drain	M6 plugged
5	Control panel	
6	Electrical component box cover	
7	Power supply inlet (Right/Left)	φ28 hole
8	Signal line inlet (Right/Left)	φ22 hole
9	Hanger	φ25 hole
10	Air filter	

Part No.	Name	Description
11	Room temperature thermistor	
12	Unit nameplate	
13	Design nameplate	
14	Instruction nameplate	
15	Overall caution nameplate	
16	Electric wiring diagram nameplate	
17	Battery charge mark nameplate	
18	High temperature caution nameplate	
19	Model nameplate	
20	Transformer	
21	Transformer box	







## Thermistor (Compatible with All Types of Oil Cooling Unit AKZ\*\*A (10 Series))


### ■ Thermistor models and applications

When this optional part is installed in the oil piping of the machine, the thermistor detects the oil or water temperature for the unit's operation.


Name	Model	Length of lead wire L (m)	Figure	Application (To be installed by you)
a r	AKZ-OP-K5	5 m	Plug-in terminal  80  80	For machine temperature
machine nization	AKZ-OP-K10	10 m		synchronization control (implanted in
for mathronization	AKZ-OP-K15	15 m	R1/8 Lead wire	the machine body)
Thermistor for machine body synchronization	AKZ-OP-A5	5 m	Plug-in terminal	For machine temperature synchronization control
	AKZ-OP-A10	10 m	G Lead wire	(attached to the surface of the machine body)
Thermistor for oil temperature control	AKZ-OP-Y5	5 m	XHP-3 (Blue) SXH-001T-0.6 80 27.5	For return oil temperature control (Installed in the oil pipe
Thermi oil temp cor	AKZ-OP-Y10	10 m	R1/8 G Lead wire	or water pipe of the machine)

Thermistor characteristics: Resistance value  $\cdots$  R25 (Resistance value at 25°C) = 20 k $\Omega$ , Tolerance:  $\pm 3\%$ 

#### ■ Instruction for installation and connection

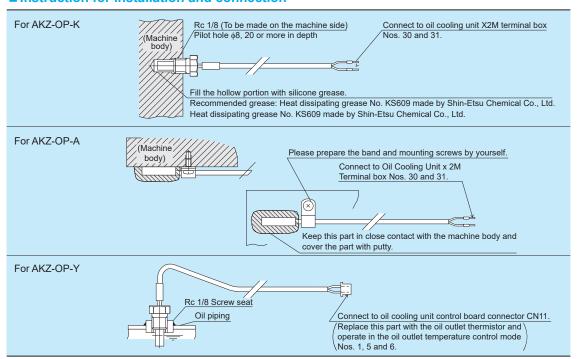

# ■ Installation positions of the thermistor for machine synchronization and thermistor for oil temperature control

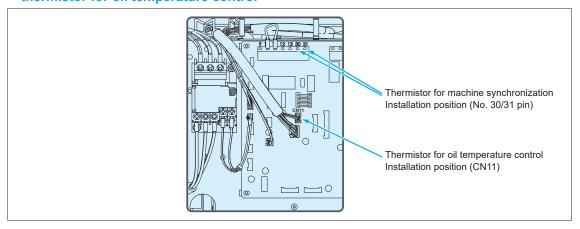

## Option Board for Communication (Serial Communication/ Parallel Communication) Compatible with 10 Series Oil Cooling Units


The following can be achieved by mounting this option board on the Oil Cooling Unit's control board and communicating with the machine.

- 1. Changing the operation mode and the operation setting from the machine
- 2. Reading various data such as the alarm code and temperature-related data (machine temperature, room temperature, inlet oil temperature, outlet oil temperature, inlet and outlet differential temperature, inverter frequency) of the Oil Cooling Unit from the machine.

Communication method	Model	Installation position	Applicable model
Serial communication RS232C	AKZA-OP-CS		PIM00603
Serial communication RS232C	AVZA OD CCD	Daikin proprietary protocol	DIMONGAA
Parallel communication AKZA-OP-CSP			PIM00614


Note: For details on the communication procedure and specifications, refer to the dedicated instruction manual

### ■ Mounting the AKZA-OP-CS serial communication option board

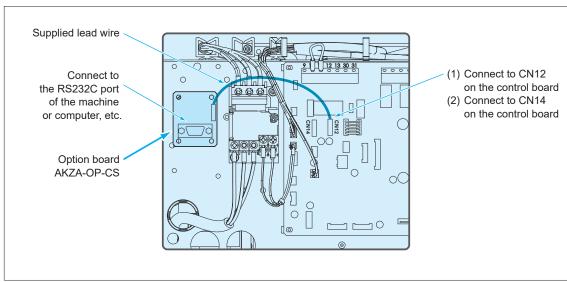


- Dimensions of communication board (W  $\times$  H): 40  $\times$  50
- The communication board is secured at four positions by locking support.

### Mounting the AKZA-OP-CSP serial communication/parallel communication option board

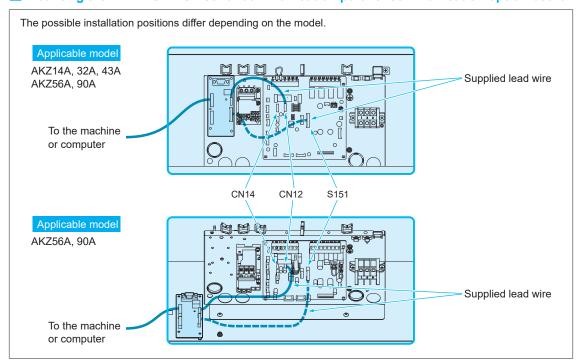

# Part Names, Functions and Operation of Control Panel

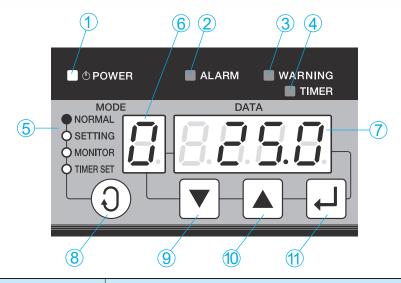


No.	Item	Description
1	Power lamp (Green)	The lamp is turned on while power is supplied.
2	Error warning lamp (Red)	When an error occurs  Level 1 alarm: The lamp keeps blinking.  Level 2 alarm: The lamp is continuously on.  For details on alarms and warnings, refer to
3	Warning lamp (Green)	When a warning occurs  Level 1 warning: The lamp keeps blinking. Level 2 warning: The lamp is turned on.
4	Timer mode lamp (Green)	The lamp keeps blinking while the machine is at a stop in the timer mode.
(5)	Operation mode display	Displays the mode of the control panel.  NORMAL: Normal mode MONITOR: Monitor mode TIMER SET: Timer setting mode
6	Operation mode/ Data No. display	Displays the current operation mode (Normal mode/Operation setting mode) or data number of the data currently displayed on the data display.
7	Data display	Displays various data. The data displayed differs depending on the operation mode and data number.
8	[SELECT] (Select) key	Selects the operation mode.
9	[DOWN] key	Decrements the value of the operation mode, data number or data by 1 (0.1). When held for two seconds or longer, decrements the values by 10 (1).
10	[UP] key	Increments the value of the operation mode, data number or data by 1 (0.1). When held for two seconds or longer, increments the values by 10 (1).
11)	[ENTER] (Determine) key	Determines the operation mode, data number, and data to be changed.

### Operation for changing to each mode

The mode can be changed by operating the (1) key in general.

To enter a special mode, hold down a number of keys in combination for more than five seconds.

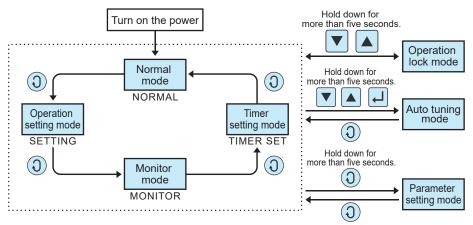



- The default setting is"Operation lock mode".
- To start operation, perform the unlocking operation as shown above.
- The default setting for operation on the standard machine is: Operation mode: 3 (Inlet oil temperature control, room temperature synchronization control)

Differential temperature: 0.0 (°C)

### **Operation Mode and Setting Method**

Watch a video on the relationship between control and accuracy!



URL https://www.hyd.daikin.com/mv/oilcon\_accuracy

### **AKZ10** series

Operation mode No.	Mode name	Description	Setting temperature range	Necessary optional part
Operation mode 0	Inlet oil temperature, fixed temperature control	Keep the inlet oil temperature at the setting temperature within the range specified in the right column.  5 to 50°C		
Operation mode 1	Outlet oil temperature or return oil temperature control, fixed temperature control	Keep the outlet oil temperature or return oil temperature at the setting temperature within the range specified in the right column.	temperature at the setting temperature within 5 to 50°C	
Operation mode 3	Inlet oil temperature, room temperature synchronization control	Keep the inlet oil temperature at the setting temperature within the range specified in the right column.	Between Room temperature –9.9°C and Room temperature +9.9°C	
Operation mode 4	Inlet oil temperature, machine temperature synchronization control	Keep the inlet oil temperature at the setting temperature within the range specified in the right column.	Between Machine temperature –9.9°C and Machine temperature +9.9°C	Machine synchronization thermistor
Operation mode 5	Outlet oil temperature or return oil temperature control, room temperature synchronization control	Keep the outlet oil temperature or return oil temperature at the setting temperature within the range specified in the right column.	tting temperature	
Operation mode 6 machine temperature control, with		Keep the outlet oil temperature or return oil temperature at the setting temperature within the range specified in the right column.	Between Machine temperature –9.9°C and Machine temperature +9.9°C	Oil temperature control thermistor (When return oil temperature is controlled) Machine synchronization thermistor

Note 1: Operation modes 2, 7, and 8 cannot be used. Note 2: Refer to Page 21 for details of required optional parts.


### ■Setting procedure

Default setting: Set to operation mode 3, and a temperature of 0.0°C

To use the equipment other than at the default setting, change the setting by following the procedure below.

- 1 Power ON ····· Release the operation lock mode before starting operation for the first time.

  (Hold down the ▼ and ▲ keys simultaneously for more than 5 seconds.)
- Select the "SETTING" operation setting mode (press the key once).

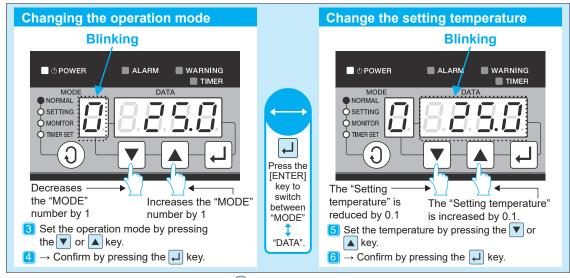

 $\overline{m{O}}$  To return to the "NORMAL" mode, press the  $\widehat{m{O}}$  key three times.

### **Points Checked in the Monitor Mode**


### The following points can be checked in the monitor mode.

Monitor No.	Description	
0	Machine body temperature [Th1]	*1
1	Outlet oil temperature or return oil temperature [Th2]	*1
2	Room temperature [Th3]	*1
3	Inlet oil temperature [Th4]	*1
4	Reserved [Th5]	*1

Monitor No.	Description	Note
5	ΔT (Th4-Th2)	*1
6	Cooling capacity control command value (%)	1
7	Compressor inverter rotational speed (rps)	-
8	Power consumption (kW)	*2
9	Extended DIN (hundreds digit), DOUT (tens digit) status	*3

- \*1. If the thermistor is not connected or has a broken wire, -99.9 is displayed.
- \*2. This is the value obtained by rough calculation under the following conditions: power supply voltage of 200 V, pump discharge pressure of 0.2 MPa (VG32: oil temperature 25°C). (Accuracy is approximately ±20% with respect to the max. power consumption.) Contact us separately about pumpless machines.
- \*3. With the default setting, 0 is displayed. Note that display is enabled when parameter n020 is "1" or the optional communication extension board is installed.

# **Electric Wiring Diagram (Typical diagram)**

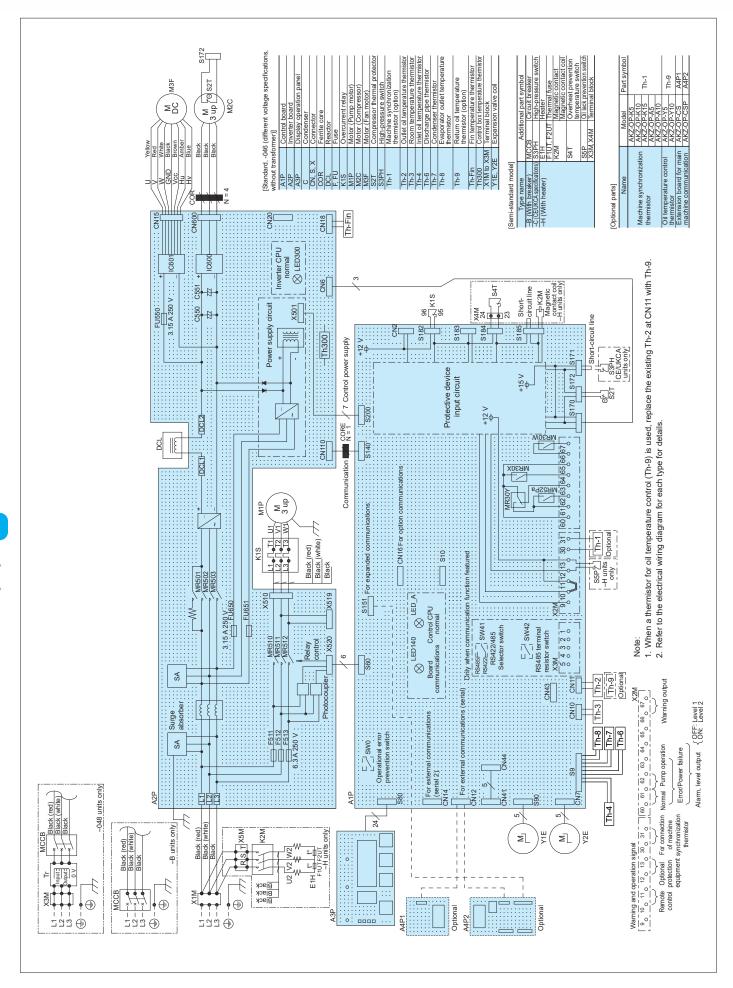

## **Electric Wiring Connection Instruction**

1 Power supply capacity ····Refer to the max. power consumption/max. current consumption in the specifications list (Pages 5 to 8).


### 2 Connection to power supply terminal block (X1M)

- In the case of the standard type and menu-incorporating type (-C, -H, -T), connect the line to X1M.
- (2) In the case of "with breaker" (–B) specifications, connect to the circuit breaker.
- 1. Screw terminal and wiring diameter

Series	Terminal Screw		Wiring diameter		
Series	block	terminal	IEC cable	UL cable	
AKZ 14A. 32A. 43A. 56A	X1M	M4, M5	2.5 mm <sup>2</sup>	AWG#14	
ANZ 14A, 32A, 43A, 30A	Breaker	M5	or greater	or greater	
AKZ 90A	X1M	M5	4.0 mm <sup>2</sup>	AWG#12	
AKZ 90A	Breaker	M5	or greater	or greater	

- 2. Use a round crimp-style terminal for connection.
- 3. The terminal block is for three poles and the earth wire is to be secured on the enclosure with a screw.

### 3 Connection to signal terminal block (X2M)




1. Straight crimp terminal and wiring diameter

Straight pin terminals	Wiring diameter				
terminals	IEC cable	UL cable			
*	0.3 mm <sup>2</sup> to 1.5 mm <sup>2</sup>	AWG#22 to #16			

- 2. Use a straight crimp-style terminal for connection.
- 3. Use stranded wires for electric connection.
- 4. The wiring size is 0.5 mm² to 1.5 mm² in the case of duplex cable according to IEC.
- If using stripped wires, make the stripped length 9 to 10 mm.
- \*Recommended models and manufacturers: TGN TC-1.25-9T (NICHIFU Co., Ltd.) APA-1.25N (Daido Solderless Terminal)

### 4 Signal output time chart

#### (1) Alarm/operation status output chart



#### (2) Warning output chart

(=) Training Sulpar Share									
Operation status			Non-warr	ing status		Warning status			
Signal output		Normal	Level 1 Error or LOCK		Power failure (Power OFF)		Level 1 Error or LOCK	Level 2 Error	Power failure (Power OFF)
Warning output ("a" contact")	66-67 ON OFF								



- 1. The following electric wires can be used on the terminal block for straight crimp-style terminals.
- Load applicable to [60 64] and [66 67] is as follows:
   Min. applicable load:
   DC 10 mV 10 μA or greater
   Max. applicable load:
   DC 30 V, 2 A (Resistance load)
- For [10] to [13], please prepare contacts to meet the condition of minimum applicable load DC 12 V and 5 mA.
- 4. When the length of the thermistor to be connected to [30] - [31] is longer than 10 m, or the wiring is routed in a poor noise environment, use shielded wire.

# **A** DANGER

(1)

 $\otimes |\otimes|\otimes|\otimes$ 

L1 L2 L3

L1 L2

- Always install an all-pole (3-pole) earth leakage breaker\* (to be prepared by you) of the specified capacity on the main power supply.
  - \*All contact distances must be at least 3 mm.
- Always ground the machine. Since a noise filter is installed, there is a risk of electrical shock without proper grounding.
- Before opening the electric component box, always turn off the power, and wait for 5 minutes until internal high voltage has been discharged.
- Do not energize the equipment with the electric component box kept open.

# A

### **CAUTION**

- To avoid the effects of noise, connect the power wire by cutting it to the proper length so that no excess wire comes into contact with the control board or elsewhere.
- To perform remote control, remove the short-circuit wire between [10] and [11] and install an operation switch (to be prepared by you).
- 3. The mode is set to "Lock mode (Stop mode)" by default. Before starting operation, follow the procedure to release the Lock mode from the control panel. Refer to page 23 for the unlocking procedure.
- 4. The unit is provided with a misoperation prevention switch (PROTECT) to reject setting from the control panel. If you want to use this function, make the necessary setting referring to the instruction manual.

### **Notes for Installing Piping Outside the Machine**

If the external pressure loss (site piping resistance) exceeds the specified use range, phenomena such as abnormal noise of the pump (relief noise, noise of cavitation), decrease of cooling capacity and control failure of oil temperature may occur.


- Suction-side piping
   Keep the suction vacuum pressure within the range between –30.7 and 0 kPa.
   The use of a suction filter of 100 to 150 mesh is recommended.
- Discharge-side piping
   Keep the pressure loss of the discharge-side piping at 0.5 MPa or less.
- 3. Do not install a stop valve on the suction or discharge side. When a stop valve must be installed on the discharge side out of necessity, use a 0.5 Mpa relief valve along with the stop valve.
- Calculation of piping resistance
   Determine the oil piping size by calculating the piping resistance according to the following equation:

Piping resistance  $\Delta P$  = 0.595 ×  $\nu$  × Q × L/D<sup>4</sup> (For use of general hydraulic oil and lubricant)

- Δ P : Piping resistance (MPa)
  - V: Dynamic coefficient of viscosity (mm²/s)-Refer to the Viscosity/Temperature Chart.
  - Q : Flow rate (L/min)
  - L: Piping length (m)
  - D: Internal piping diameter (mm)


### Relationship between oil flow rate and external pressure loss

An AKZ 10 series Oil Cooling Unit incorporating a pump of the circulation type has the characteristics shown below. When the external pressure loss ( $\Delta$ p) is 0.5 MPa or less, the rated flow rate (Q0) is achieved, but when the external pressure loss exceeds 0.5 MPa, the flow rate becomes lower than the rated flow rate.

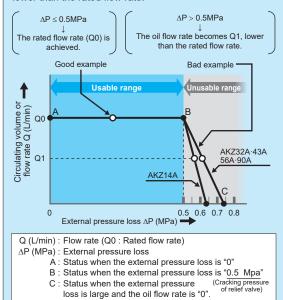

Note: Design the site piping to withstand a pressure of at least 1.0 Mpa.

### **■**Viscosity/Temperature Chart

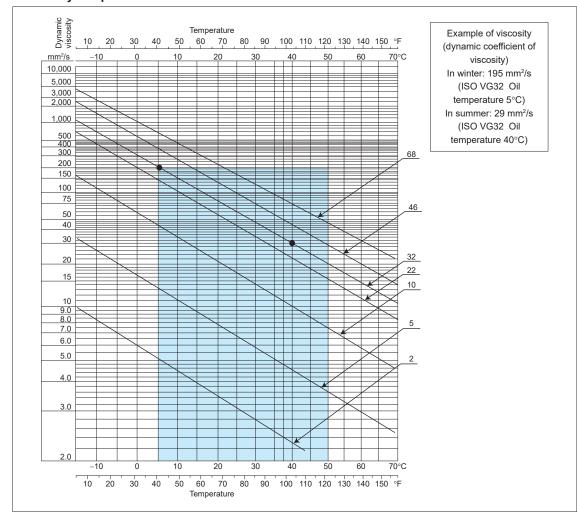

### **Notes for Handling**

- Important notes to be observed regarding the machine side (machine tools and industrial machinery)
- 1. When rough transport conditions are expected while transporting the machine overseas or elsewhere, special precautions should be taken in the packaging and transportation method so as to avoid the application of excessive force on the oil cooling unit (this unit).
- 2. The Oil Cooling Unit (this unit) does not incorporate a flow switch for checking the oil supply or a temperature switch for abnormal temperature (high temperature or low temperature) of oil supplied. So, please provide protection devices such as a flow switch and temperature switch.

### Notes for operation and cooling capacity

- 1. Do not use the oil cooling unit to cool oil from 50°C or higher. Start to operate the oil cooling unit at the same time as the machine or before the oil temperature rises to 40°C.
- 2. Do not place an object that hinders ventilation within 500 mm of the air-intake or exhaust.
- 3. If the air filter is clogged, the cooling capacity will be reduced. Clean the air filter (wash with warm water or clean with air) periodically once every two weeks to prevent clogging.

### Notes on usable fluids with oil cooling units

- 1. The cautions are given in the table below. (✓ symbol ··· Can be used, "Unusable" ··· Cannot be used)
- 2. Do not use fluid listed below as "Unusable"

	Description	AKZ10 series
Lubricating oil Mineral hydraulic oil	Oil that is classified as third class petroleum or fourth class petroleum of the fourth group hazardous materials stipulated in the Fire Defense Law and that corresponds to discoloration No. 1 in the copper corrosion test method (JIS K2513) of petroleum products Oil that satisfies pollution level NAS 10	<b>√</b>
Nonflammable hydraulic oil  Phosphate ester hydraulic fluid Chlorinated hydrocarbon series Water - Glycol series W/O & O/W emulsion series (High-aqueous hydraulic oil)		Unusable
<ul> <li>Coolant fluid</li> <li>Water-soluble cutting and grinding fluid</li> <li>Non water-soluble cutting and grinding oil</li> </ul>		Unusable
Ethylene glycol (Antifreeze liquid)		Unusable
Water (Industrial water)		Unusable
Inflammable liquids like fuel	Liquid equivalent to special flammables, alcohol, first class petroleum and second class petroleum of the fourth group hazardous materials specified according to the Fire Defense Law	Unusable
Chemicals		Unusable
Liquid for food products	Drinking water, water for cooling food products, etc.	Unusable

### **Notes for Handling**

Before operating this unit, be sure to read the operation manual and properly understand it.

### • Instructions for safe operation

ADANGER ..... Failure to observe the instruction may cause an imminent hazardous situation that may Signs and result in personal death or serious injury. <u>Instructions</u> WARNING... Failure to observe the instruction may result in personal death or serious injury. ⚠CAUTION ··· Failure to observe the instruction may result in personal injury or damage to the property.

### (1) General instructions

[\(\triangle DANGER\)] ① Use the equipment only in accordance with the intended specifications (specified in brochure, specification sheet, operation manual, and caution plates).

[\(\frac{\tag{\tag{N}}}{\tag{DANGER}}\)] \(\tag{\tag{N}}\) Never operate the equipment in an explosive atmosphere.

[ADANGER] 3 Do not disassemble, repair or modify the equipment by yourself.

[ NANGER ] ④ Always comply with the laws and regulations for safety (Industrial Safety and Health Law, Fire Defense Law, and JIS B 8361 Guidelines of Hydraulic System).

- Ventilate the room adequately (to avoid the risk of suffocation).
- Avoid direct contact of the refrigerant with skin (to avoid the risk of cryogenic burns).
- · In the event of inhalation of a great deal of refrigerant, contact with skin, or refrigerant in the eye, seek medical attention immediately.
- [MARNING] © In the event of an abnormal condition, stop operation promptly, investigate the cause of the problem and take appropriate remedial measures.
- lot of dust, contamination, steam, oil mist or corrosive gases: H2S, SO2, NO2 or Cl2).
- [! CAUTION] Install a flow switch and temperature switch on the machine to protect the spindle and other components.
- [ CAUTION] 

  Do not get on the equipment or place an object on the equipment.
- [ CAUTION] @ Use the unit at an altitude of up to 2,000 m. At altitudes in excess of 1,000 m the cooling capacity decreases by around 20 to 30%, so please select a model with adequate leeway in terms of cooling capacity.

### (2) Instructions for transportation

- [MDANGER] ① When hoisting the equipment, check its weight and use the eye plates and hangers on it properly.
- [! DANGER] ② When hoisting the equipment, do not do so while it is fitted with a tank or anything else that you have provided.
- [ACAUTION] When moving the equipment, take appropriate measures for fall prevention.
- [ CAUTION] ⑤ Do not tilt the equipment 30 degrees or more while transporting it (including during storage).

#### (3) Instructions for installation

- $[N \setminus WARNING]$  ① Install the equipment on a rigid, level foundation and secure it appropriately.
- [ACAUTION] ② Do not place an object near the suction port or discharge port of the equipment.

### 4 Instructions for wiring and piping installation

- [\(\triangle DANGER\)] \(\triangle \) Wiring and piping installation should be performed by a person with specialized knowledge and skills.
- [ NANGER ] ② Always use a commercial power supply for the power source. (The use of an inverter power supply may cause burn damage).
- [\(\triangle DANGER\)] 3 Connect the wiring for power supply in accordance with the electric wiring instruction diagram of the specification sheet and operation manual.

- [A WARNING] ⑤ Install the wiring in accordance with the standard by checking the electric wiring diagram.
  [A CAUTION] ⑥ Always install a dedicated all-pole (3-pole) earth leakage breaker appropriate for the capacity of Oil Cooling Unit on the main power supply on site.
- [ACAUTION] The Check that the oil piping has a pressure resistance of at least 1 MPa (and is usable at negative pressures too at the suction side) and install it reliably.

### (5) Instructions for trial run

- [ \( \text{CAUTION} \) \( \text{O} \) Check to see that the machine is in a safe status (not activated) before starting the trial run.
- [ \( \text{CAUTION} \) \( \text{Q} \) Check to see that the oil piping and electric wiring are correctly connected to the machine and that there is no looseness in connections and joints.
- [ACAUTION] ③ Disable the operation lock of the equipment (Oil Cooling Unit) before starting the machine.
- [ACAUTION] 4 Check to see that the required amount of oil is in the oil piping system and that the piping is not blocked partway along.

### (6) Instructions during operation

- [ \( \text{DANGER} \) \( \text{D} \) Do not splash water or liquid on the equipment.
- [MARNING] ② Do not push your finger or an object into gaps of the equipment.
- [ACAUTION] 3 Do not touch the heated exhaust port of the equipment.

### (7) Instructions for maintenance and inspection

- [/ DANGER] ① Perform maintenance and inspection with the equipment kept open. Working in a closed status may result in suffocation due to the leak of refrigerant.
- [\(\time\) DANGER] ② Always turn off the main power supply before starting maintenance and inspection.
- [/NDANGER] 3 Wait for five minutes after turning off the main power supply before starting maintenance and inspection operation.
- DANGER @ Do not operate the equipment with its cover opened.
- [ACAUTION] © Clean the air filter periodically (once every two weeks in general).
- [ACAUTION] The Keep oil cleanliness to NAS 10 level or lower according to the pollution level.
- [ACAUTION] ® Check the oil level in the tank and ensure that it is between the yellow line and the red line.
- [ACAUTION] (9) Inspect the underneath (drain pan) of the oil cooling unit once every six months, and if oil has accumulated, discharge it through the oil drainage port.


## **Selection Method for Oil Cooling Units**

Unit conversion formula ●1 kW = 860 kcal/h

- Select an oil cooling unit with a cooling capacity 20 to 30% larger than the amount of heat generated from the machine tool.
- 2. Since the cooling capacity of an oil cooling unit varies with changes in fluid temperature (fluid inlet temperature) and room temperature, the fluid temperature and room temperature conditions must be clarified in order to select the appropriate oil cooling unit.
- 3. Three methods are shown below as a guide to estimating the amount of heat generated from the machine tool. Ultimately, tests have to be conducted to determine the exact amount of heat generation for selecting the appropriate oil cooling unit.

# Example calculation 1

Estimating the amount of heat generation from the temperature difference between the inlet and outlet for oil going to the machine



$$Q = \frac{Vs \times \rho \times Cp \times \Delta T}{1000 \times 60}$$

Q : Heat release value (kW) Cp: Specific heat (kJ/kg·°C)

Vs : Flow rate (L/min)  $\Delta T$  : Temperature difference (°C)


Example calculation

When "Vs" is 30 L/min and "∆T" is 5°C

$$Q = \frac{30 \text{ L/min} \times 876 \text{ kg/m}^3 \times 1.97 \text{ kJ/kg}^{\circ}\text{C} \times 5^{\circ}\text{C}}{1000 \times 60}$$

$$\approx 4.31 \text{ kW}$$

# Example calculation 2 When it is desired to reduce the temperature of the oil in the tank within a fixed time



$$Q = \frac{V \times \rho \times Cp \times \Delta T}{1000 \times 60 \times t}$$

Q: Heat release value (kW) Cp: Specific heat (kJ/kg·°C)

V : Tank oil capacity (L) ΔT : Temperature difference (°C)

 $\rho$ : Density (kg/m<sup>3</sup>) t : Time (min)

Example when it is desired to cool 200 L of hydraulic calculation oil from 50°C to 40°C within 15 minutes

Q = 
$$\frac{200 \text{ L} \times 876 \text{ kg/m}^3 \times 1.97 \text{ kJ/kg}^{\circ}\text{C} \times (50 - 40)^{\circ}\text{C}}{1000 \times 60 \times 15 \text{ min}}$$

A cooling capacity of **approx. 3.83 kW** or greater is required.

# Example calculation 3 When the motor output loss is considered to be the amount of heat generation

$$Q = H \cdot \frac{\eta}{100}$$

Q: Heat release value (kW)

 $\mathsf{H}\,:\,\mathsf{Motor}\,\mathsf{output}\,(\mathsf{kW})\cdots\,\mathsf{For}\,\mathsf{driving}\,\mathsf{the}\,\mathsf{spindle}$ 

η: Motor output loss (%)

Example calculation

When the output loss is 30% with a motor output of 7.5 kW

→ The output loss is 30% or so in general (Cooling of main shaft head)

 $Q = 7.5 \times 0.3 = 2.3 (kW)$ 

Note: Effect of heat absorption and dissipation from the surface of the tank and piping

Depending on the tank and piping surface area and ambient temperature, heat absorption and heat dissipation
may increase. If the effect of heat absorption and heat dissipation is large, select a model with this effect taken
into account.

### Physical property values

Name of substance	Specific heat kJ/(kg·°C)	Density (kg/m³)
Water	4.18	998
Lubricating oil/hydraulic oil	1.97	876
Water-soluble coolant (10x dilution with water)	3.94 to 4.10	991
Aluminum	0.900	2710
Iron	0.460	7870
Copper	0.385	8960

- \* The numbers in the table are reference values, so please use them as a guide.
- \* All property values (some being calculated values) are at 20°C.





## DAIKIN INDUSTRIES, LTD.

Oil Hydraulic Equipment

### Osaka Office

YODOGAWA PLANT

1-1, Nishi-Hitotsuya, Settsu, Osaka 566-8585, Japan

Phone: 81-6-6349-4475 Fax.: 81-6-6349-7862

Home Page: https://www.hyd.daikin.com

### All World Machinery Supply, Inc.

### A member of DAIKIN group

6164 All World Way, Roscoe, IL 61073, U.S. A.

Phone: +1-815-943-9111 Fax.: +1-815-943-5370

Home Page: https://www.allworldmachinery.com/

● Contents in this catalog are subject to change for improvement without prior notice.